


Frequency response after a 1,500 MW generation loss in eastern Japan
in the government scenario

Figure 8

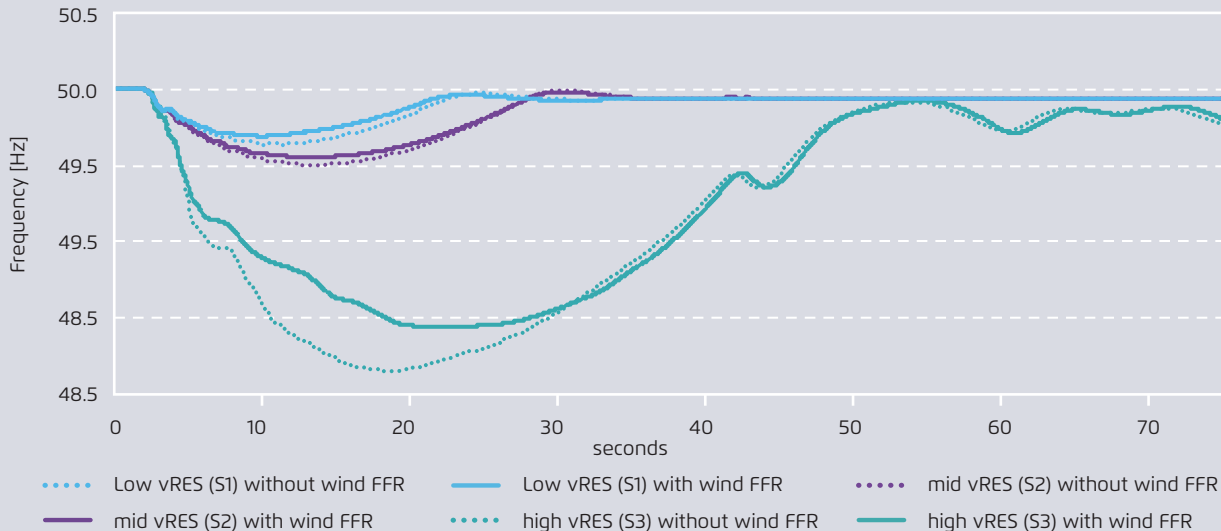

No.	Snapshot	RoCoF (Hz/s)		Frequency nadir (Hz)	
		No FFR	Wind FFR	No FFR	Wind FFR
S1	Low_VRES	-0.044	-0.037	49.64	49.695
S2	Med_VRES	-0.058	-0.052	49.507	49.558
S3	High_VRES	-0.136	-0.105	48.154	48.447