


Frequency response after a 1,500 MW generation loss
in western Japan in the government scenario

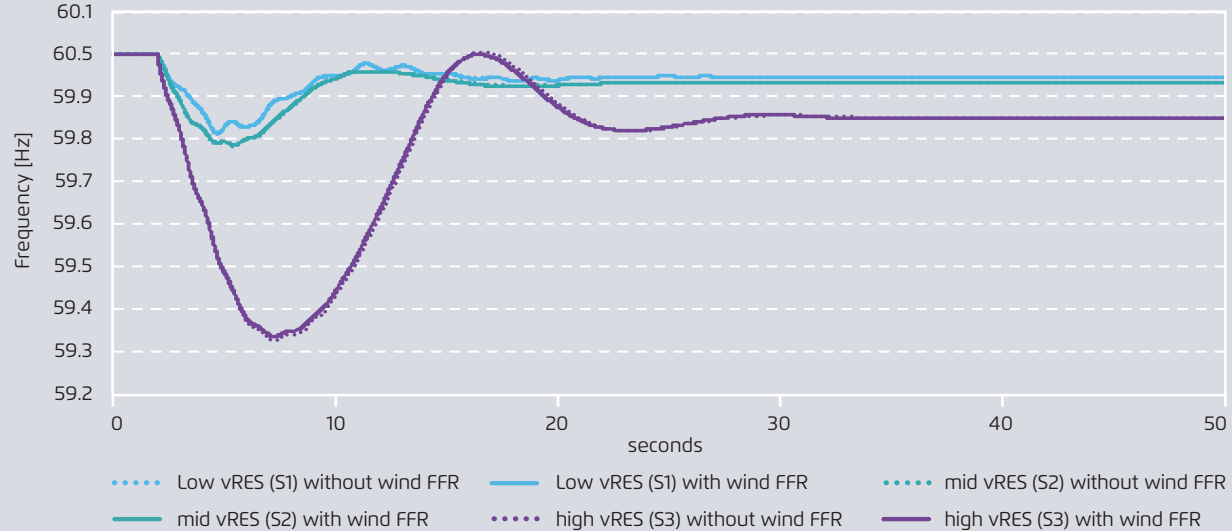

No.	Snapshot	RoCoF (Hz/s)		Frequency nadir (Hz)	
		No FFR	Wind FFR	No FFR	Wind FFR
S1	Low_VRES	-0.069	-0.068	59.812	59.813
S2	Med_VRES	-0.063	-0.061	59.783	59.786
S3	High_VRES	-0.128	-0.126	59.326	59.34